


NOTES: (UNLESS OTHERWISE SPECIFIED)

1. WELDED STAINLESS STEEL CONSTRUCTION
2. APPROX .06" THICK SHEET STK.
3. MAKE 1 PER PUMP STATION

REV.	DATE	DCN #	DRAWING TREE #
A	4-21-04	E040214-00-D	

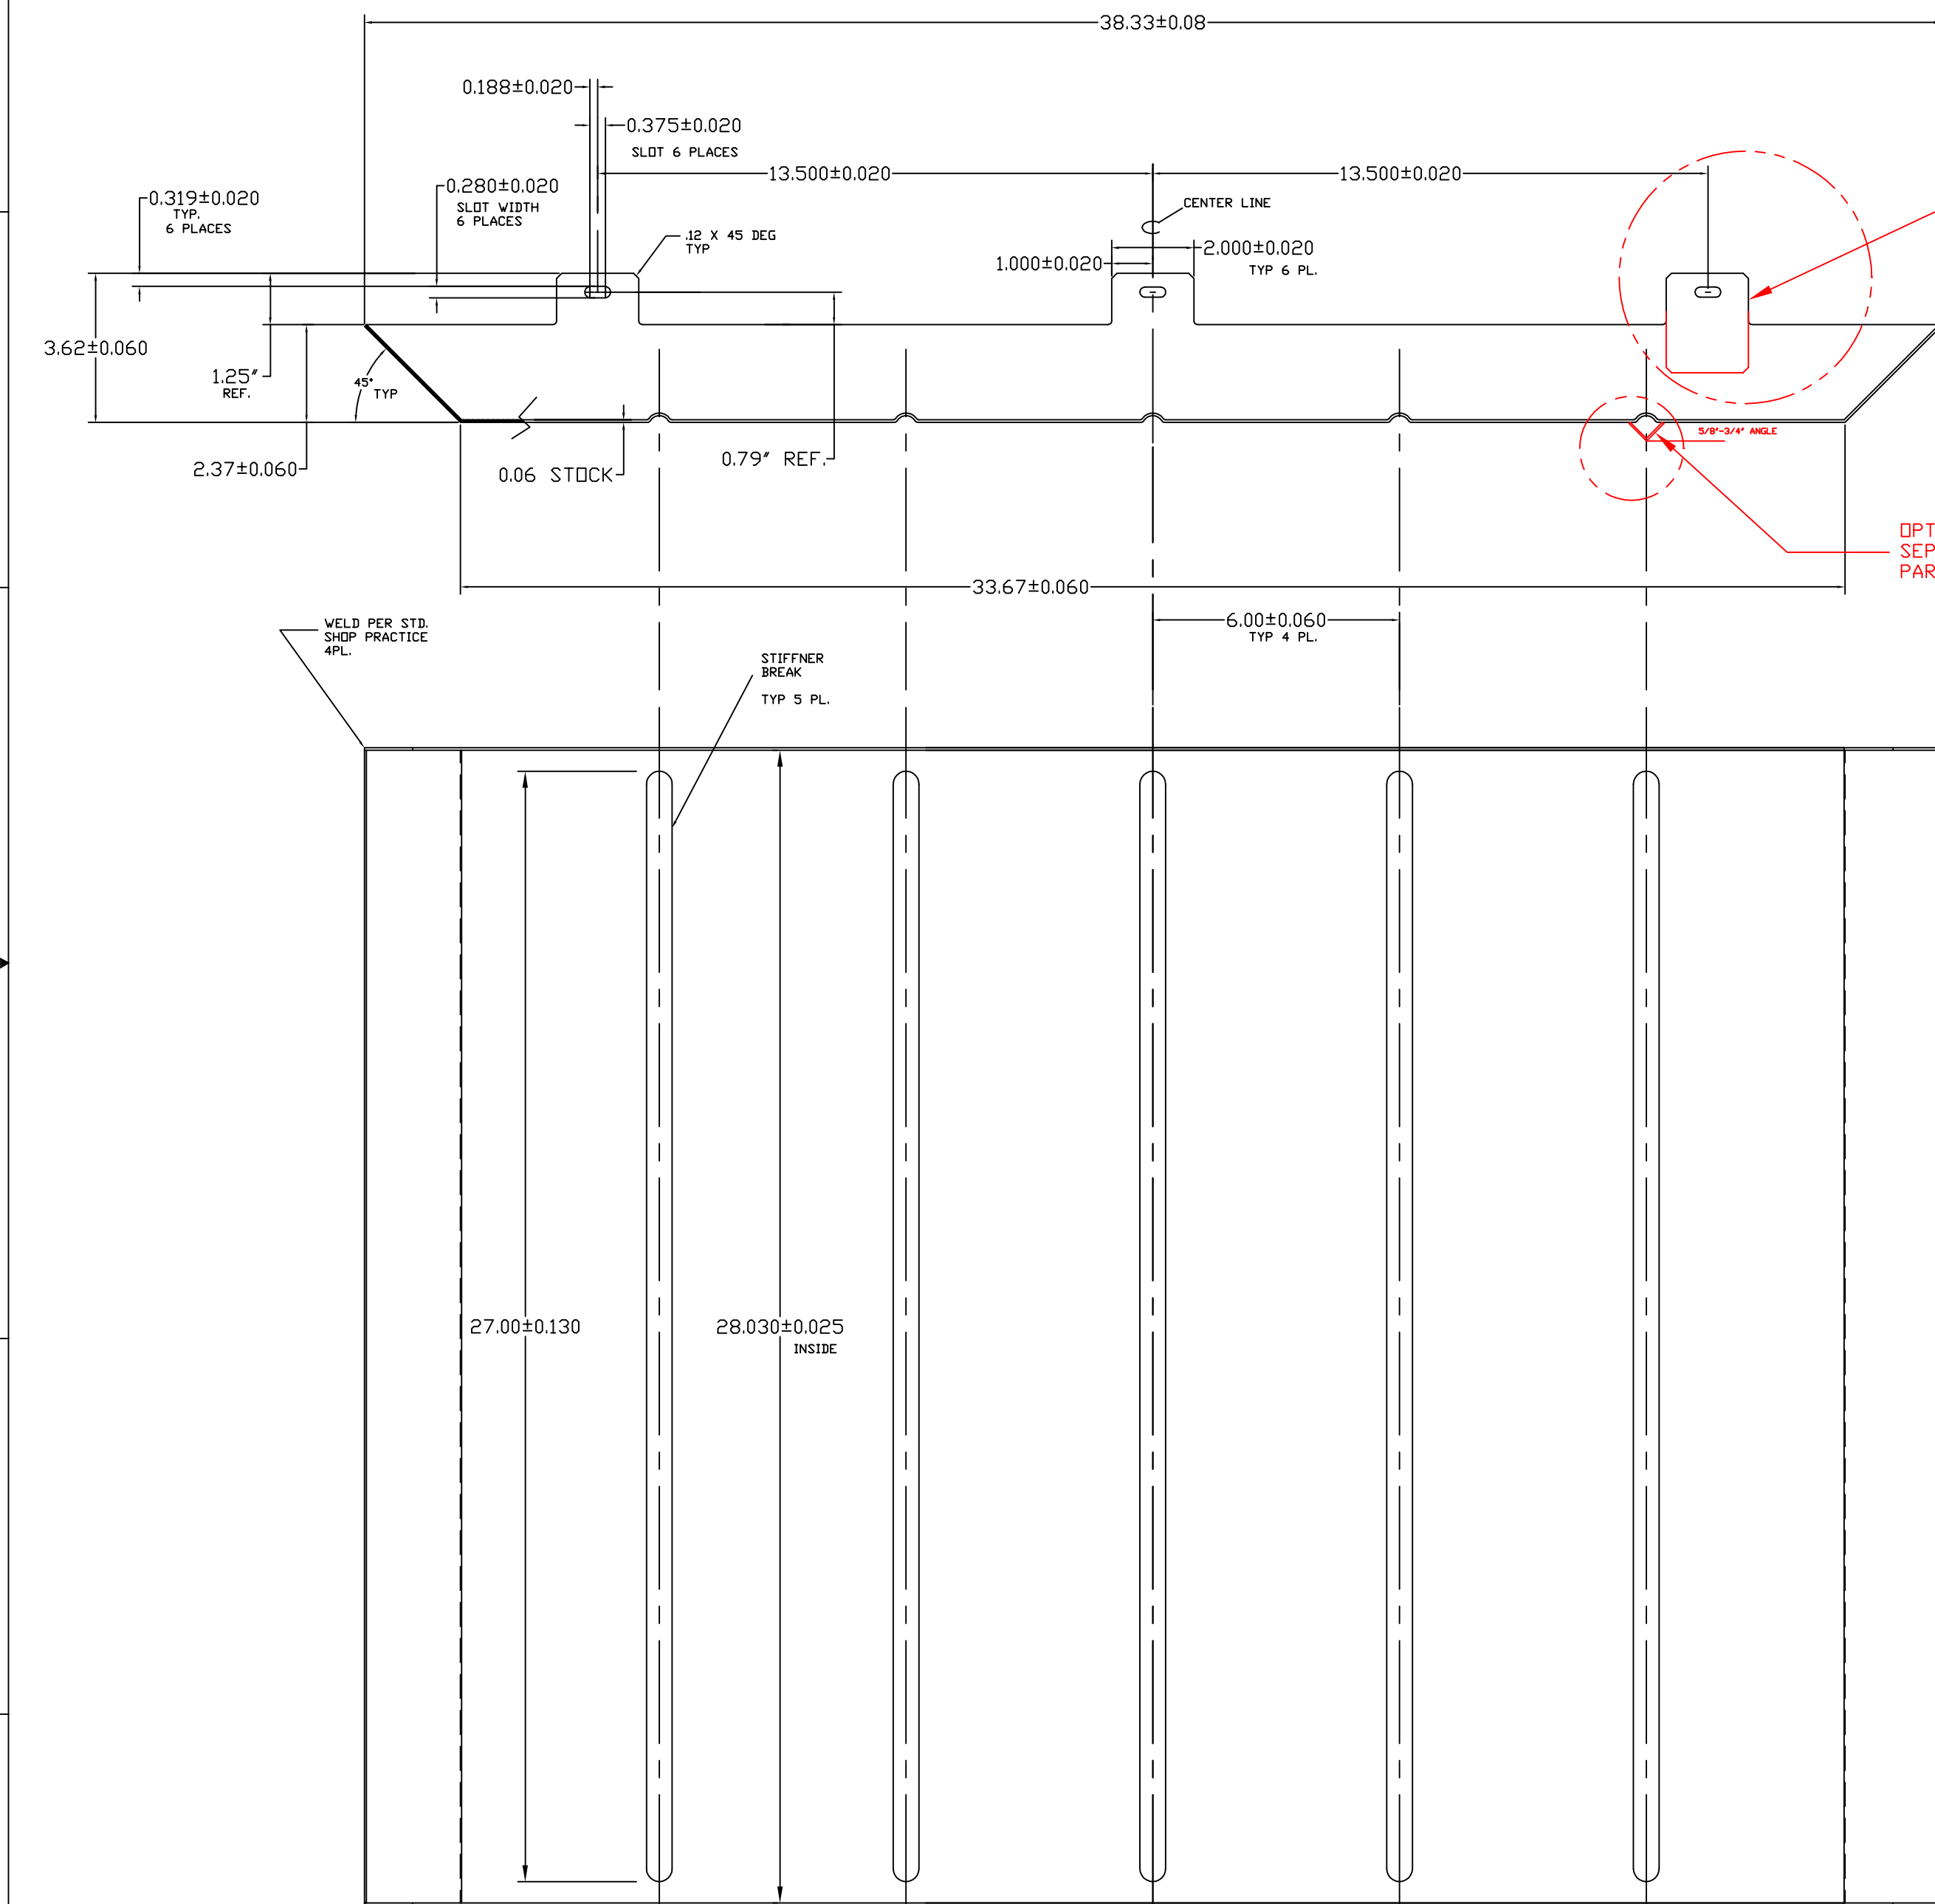

OPTIONAL SEPARATE PART

OPTIONAL SEPARATE PART

ITEM NO.	REQ. QUANTITY	SPARE	TOT. QUANTITY	PART NUMBER	DESCRIPTION	SUPPLIER
PARTS LIST						
UNLESS OTHERWISE SPECIFIED:				DATE	NAME	
DIMENSIONS ARE IN INCHES				DRAWN	4/21/04	KENM
TOLERANCES:				LIGO CALIFORNIA INSTITUTE OF TECHNOLOGY MASSACHUSETTS INSTITUTE OF TECHNOLOGY		
XX ± .005				CHECKED		
XXX ± .01						
ANGULAR ± 3 DEG						
MATERIAL: STAINLESS STEEL SHT.						
FINISH: NONE						
COMMENTS:				SIZE	DWG. NO.	REV
				C	D030788-A	A
				SCALE:		SHEET 1 OF 1