This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

DATE: 07/01:96 TIME: 17:34:35
DESIGN FILE: I:\ligo\site1\mu\wah116.d3z

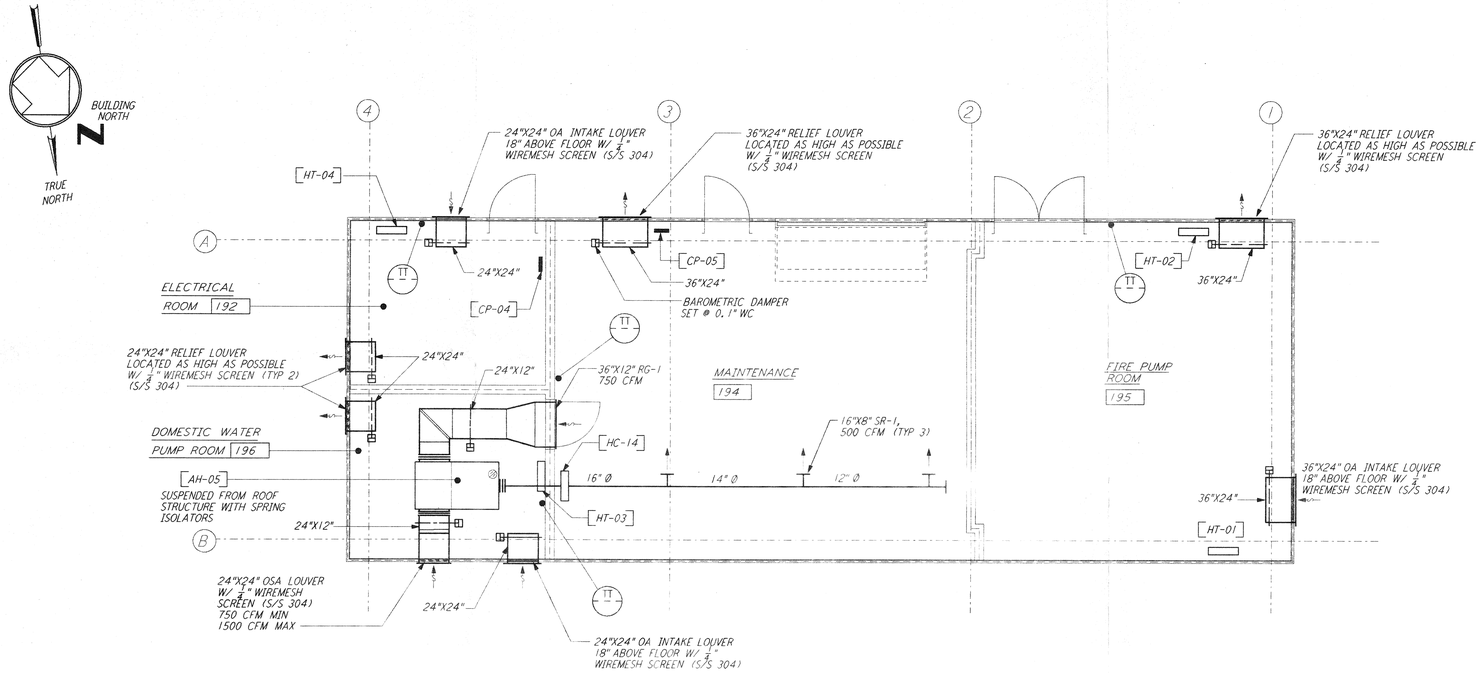

MAINTENANCE BUILDING FLOOR PLAN

1/4" = 1'-0"

NOTES:

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES SEE SHEETS WA-H-001 AND WA-H-002.

SEQUENCE OF OPERATION:

MAINTENANCE ROOM:

UPON A SIGNAL FROM THE CENTRAL CONTROL SYSTEM THE AIR HANDLING UNIT (AH-05) SHALL START. THE DDC CONTROL SHALL PERFORM THE FOLLOWING:

A. THE DDC CONTROLS SHALL MODULATE THE CONTROL DAMPERS ON THE OUTSIDE AIR AND THE RETURN AIR DUCTS TO MAINTAIN THE ROOM TEMPERATURE AT 72°F AND MAINTAIN 750 CFM OF OUTSIDE AIR MINIMUM.

B. WHEN THE ROOM TEMPERATURE DROPS BELOW 68°F THE DDC CONTROL SHALL ACTIVATE THE ELECTRIC DUCT HEATER (HC-14) TO MAINTAIN THE ROOM AT 68°F.

C. AFTER BUSINESS HOURS THE DDC CONTROLS SHALL CLOSE OFF THE OUTSIDE AIR DAMPER AND FULLY OPEN THE RETURN AIR DAMPER AND MAINTAIN THE ROOM TEMPERATURE AT 65°F.

D. IF THE ROOM TEMPERATURE DROPS BELOW 50°F, THE DDC CONTROLS SHALL REPORT AN ALARM SIGNAL TO FACILITY CONTROL AND MONITORING SYSTEM AT THE CORNER STATION.

FIRE PUMP ROOM:

A. THE PACKAGED CONTROLS ON THE ELECTRIC CONVECTOR SHALL MAINTAIN THE ROOM TEMPERATURE AT 60°F.

B. IF THE ROOM TEMPERATURE RISES ABOVE 104°F THE DDC CONTROLS SHALL OPEN THE GRAVITY VENTILATION DAMPERS. THE GRAVITY VENTILATION DAMPERS SHALL CLOSE WHEN THE ROOM TEMPERATURE DROPS BELOW 95°F.

C. IF THE ROOM TEMPERATURE RISES TO 110°F OR DROPS BELOW 50°F, THE DDC CONTROLS SHALL REPORT AN ALARM SIGNAL TO FACILITY CONTROL AND MONITORING SYSTEM AT THE CORNER STATION.

DOMESTIC WATER PUMP ROOM:

SAME AS FIRE PUMP ROOM.

ELECTRICAL ROOM:

SAME AS FIRE PUMP ROOM.

INPUT/OUTPUT SUMMARY FOR MAINTENANCE BUILDING

SYSTEM, APPARATUS, OR AREA POINT DESCRIPTION	INPUTS: ANALOG MEASURED: TEMPERATURE	PRESSURE	RH	KW	AIR FLOW	LEVEL	GALLONS	GPM	ANALOG CALCULATED: KWH	ENTHALPY	RUN TIME	EFFICIENCY	WET BULB TEMP	BINARY: STATUS	FILTER	SMOKE	FREEZE	AIR FLOW	METER	OUTPUTS: DIGITAL: OFF-ON	OFF-AUTO-ON	OFF-HI-LO	OPEN-CLOSE	MULTI-STAGE	ANALOG: DAMPER POSITION	VALVE POSITION	SET POINT ADJUSTMENT	VANE POSITION	SCR CONTROL	SYSTEM FEATURES: ALARMS: HI ANALOG	LOW ANALOG	HI BINARY	LOW BINARY	PROOF	PROGRAMS: TIME SCHEDULING	DEMAND LIMITING	DUTY CYCLE	START/STOP OPTION	ENTHALPY OPTION	SMOKE CNT	TREND	ALARM INSTRUCT	MAINT WK ORD	GENERAL: COLOR GRAPHIC	SUPPLEMENTARY NOTES
AIR HANDLING UNIT, AH-05														●	●					●					●											●					●		●		PROVIDE NIGHT TIME SETBACK
HEATING COIL, HC-14	●													●						●						●				●	●										●			
CONVECTOR, HT-01														●												●															●			
CONVECTOR, HT-02														●																											●			
CONVECTOR, HT-03														●																											●			
CONVECTOR, HT-04														●																											●			
ROOM TEMPERATURE (195)	●																													●	●									●			
ROOM TEMPERATURE (194)	●																													●	●									●			
ROOM TEMPERATURE (196)	●																													●	●									●			
ROOM TEMPERATURE (192)	●																													●	●									●			
GRAVITY DAMPERS (RM 195)																							●																				
GRAVITY DAMPERS (RM 196)																							●																				
GRAVITY DAMPERS (RM 192)																							●																				
FLOOR PLAN																																										●		

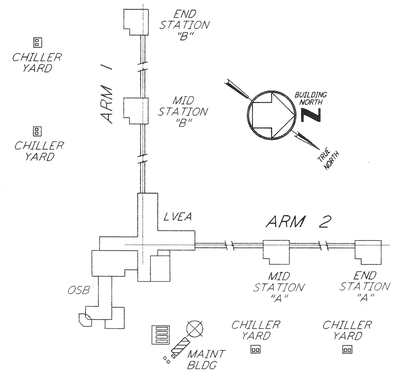

KEY PLAN

0 4 8 12 16FT
1/4" = 1'-0"

REFERENCES

DRAWING NO.	DESCRIPTION

REVISIONS

NO.	DATE	BY	CHKD	ENGR	PROJ	DESCRIPTION
0						ISSUED FOR CONSTRUCTION

DRAWN	CLP	6-24-96
CHECKED	MW2	7/3/96
ENGINEER	AA	7/3/96
PROJ	MW	7/3/96

EXPIRES 10-8-96

PARSONS
100 WEST WALNUT STREET
PASADENA, CALIFORNIA

LIGO
CALIFORNIA INSTITUTE OF TECHNOLOGY
MASSACHUSETTS INSTITUTE OF TECHNOLOGY

LASER INTERFEROMETER GRAVITATIONAL-WAVE OBSERVATORY
SITE NO. 1 - HANFORD, WASHINGTON

TITLE: HVAC CORNER STATION MAINTENANCE BUILDING FLOOR PLAN

SCALE	CONTRACT NUMBER	PROJECT NUMBER
AS NOTED	PP150969	8094

SHEET NUMBER: WA-H-116 REVISIONS: 0

LIGO-D960353-00-O

LIGOWAF3.BDR