




PLAN SYMBOLS

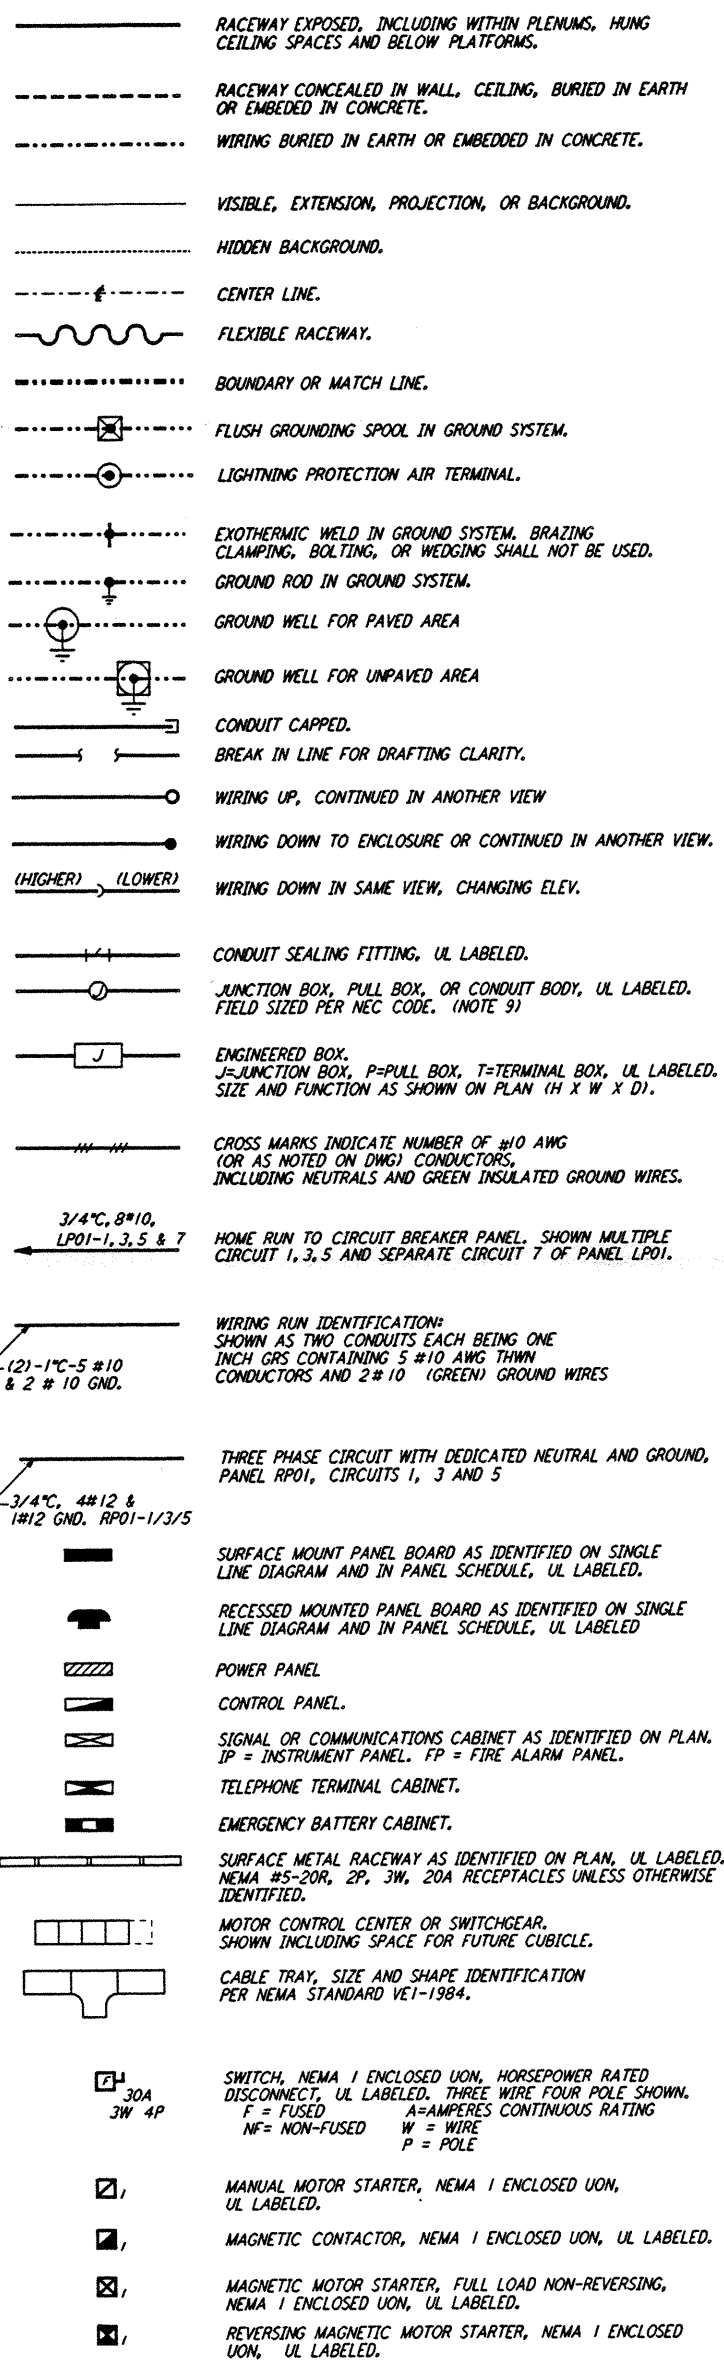

PLAN SYMBOLS

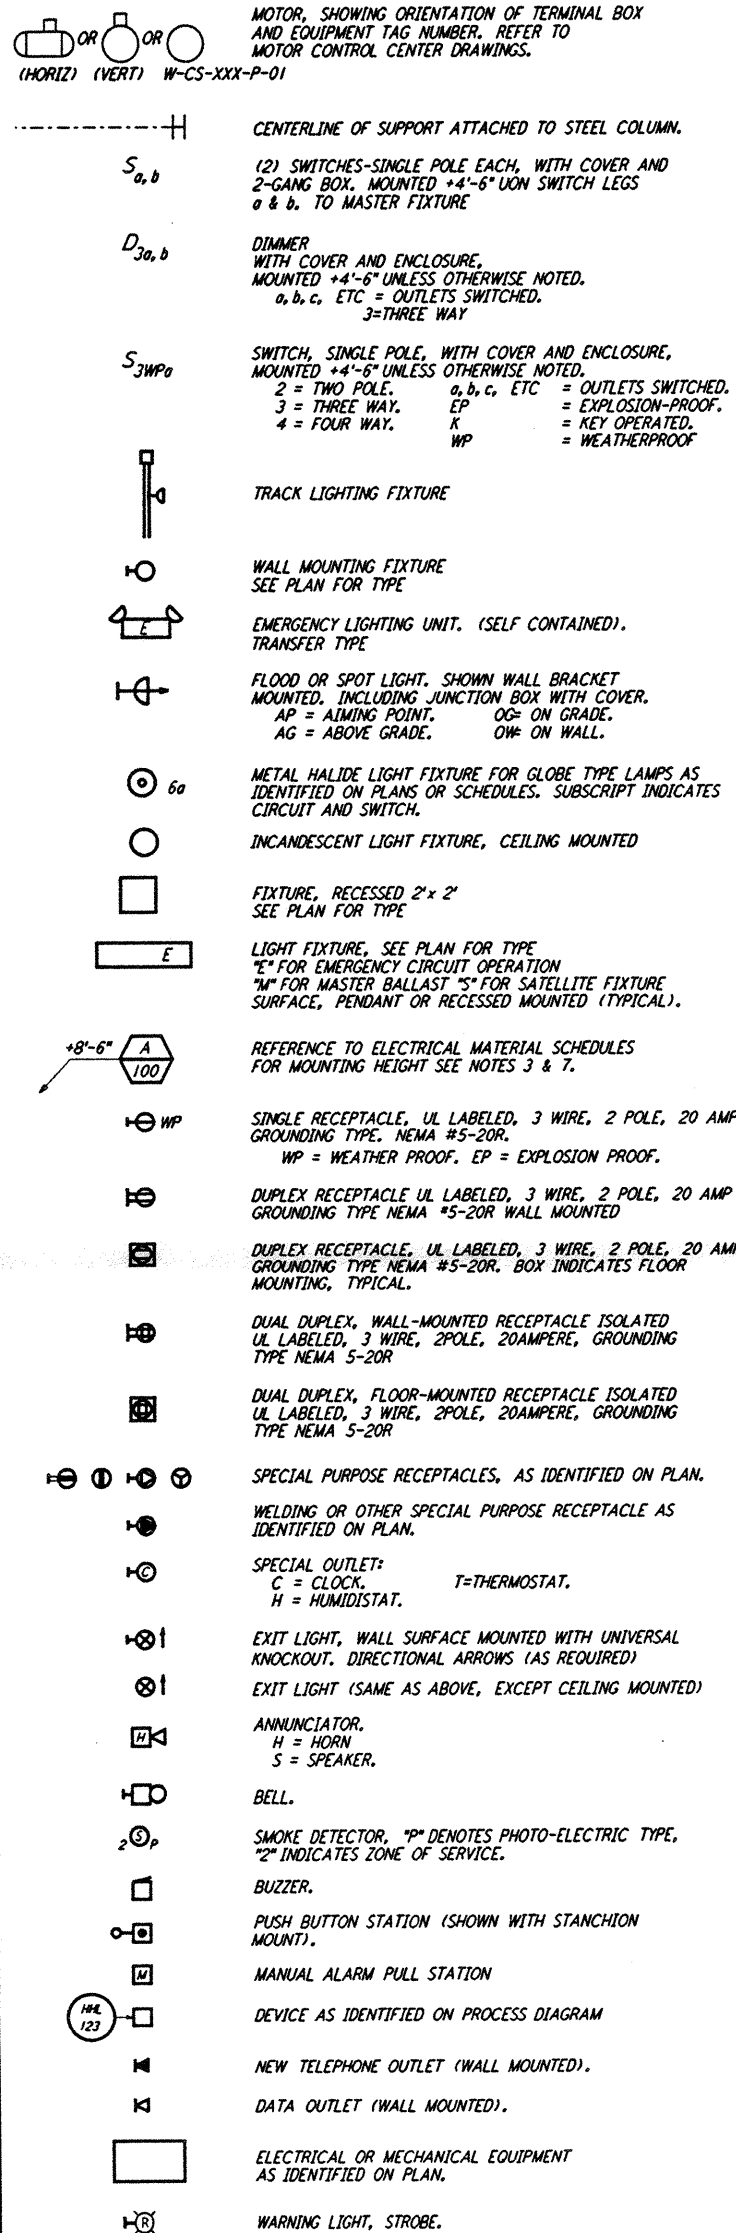

PLAN SYMBOLS

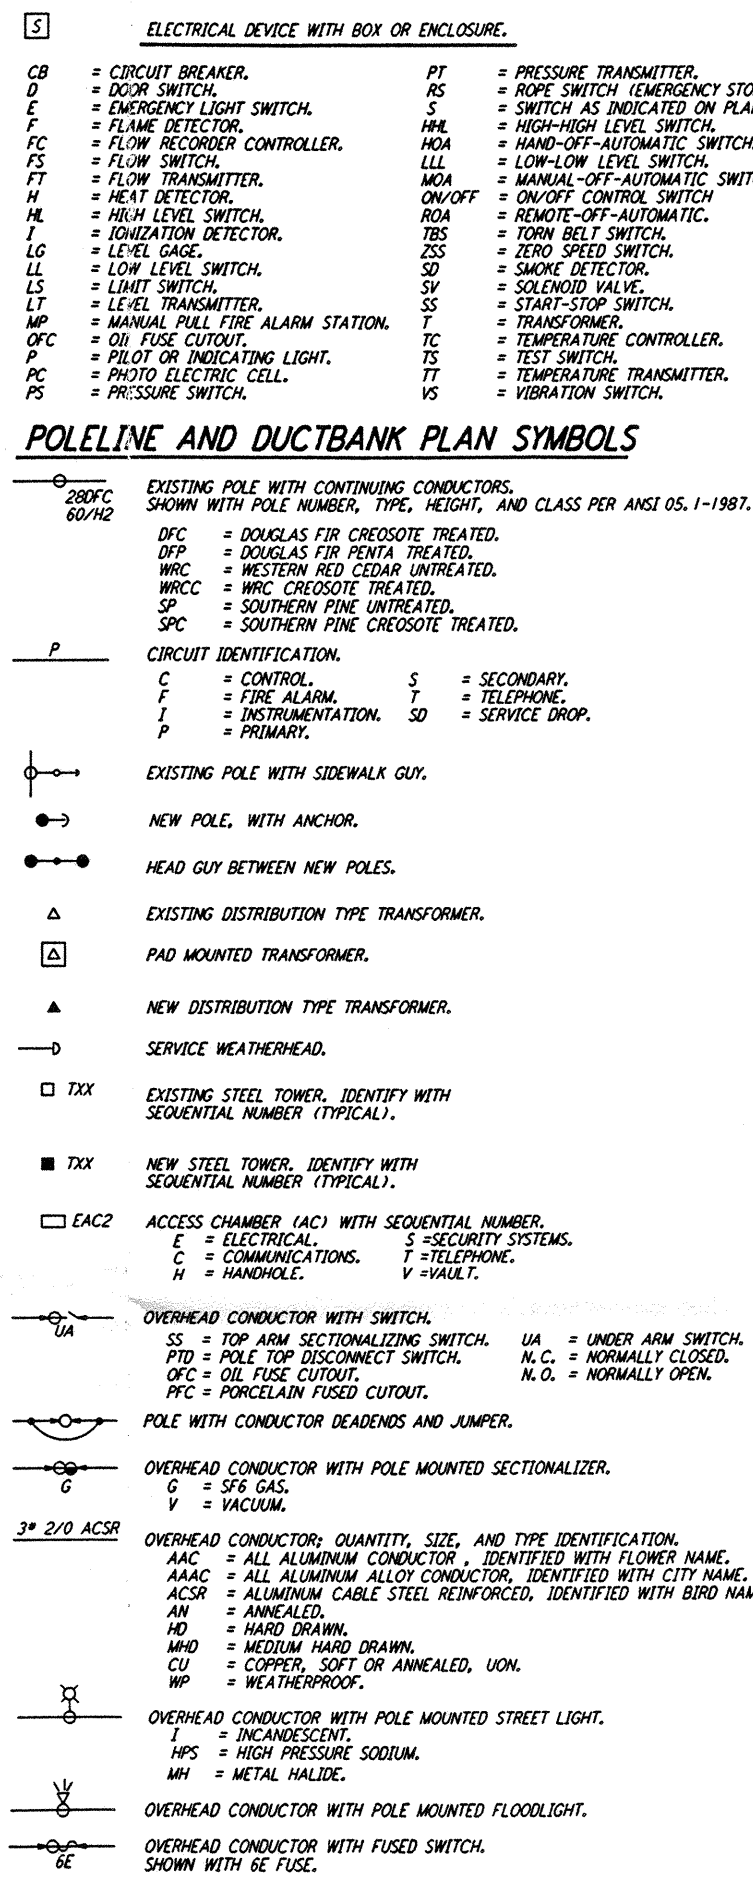

POLELINE AND DUCTBANK PLAN SYMBOLS

NOTES:


- APPROPRIATE BOX AND COVER SHALL BE PROVIDED WITH ALL OUTLETS, SEE SPECIFICATIONS.
- NOT USED.
- MOUNTING HEIGHT OF EQUIPMENT, UNLESS OTHERWISE NOTED, SHALL BE ABOVE FINISHED FLOOR AS FOLLOWS:
 - LIGHTS OVER DOORS, 1'-0" ABOVE DOOR OPENING TO BOTTOM OF FIXTURE.
 - LOCAL SWITCHES, 4'-6" TO CENTERLINE.
 - OFFICE AND CONTROL ROOM RECEPTACLES 1'-6" TO CENTERLINE.
 - OTHER RECEPTACLES, 3'-6" TO CENTERLINE.
 - LIGHTING PANELS, 6'-6" MAXIMUM TO TOP CIRCUIT BREAKER.
- EMERGENCY LIGHTING SYSTEM BRANCH CIRCUIT RACEWAY AS WELL AS FIRE ALARM AND DETECTION RACEWAY SHALL BE INDEPENDENT OF OTHER RACEWAY SYSTEMS.
- MINIMUM CONDUCTOR SIZE FOR ALL LIGHTING AND 120V CONVENIENCE RECEPTACLE CIRCUITS SHALL BE AWG #12, 600V, TYPE THW INSULATION STRANDED COPPER WIRE, UNLESS OTHERWISE NOTED, CONNECTIONS SHALL BE MADE WITH CRIMP LUGS AND CRIMP CONNECTORS, WIRE NUTS SHALL NOT BE USED.
- FLEXIBLE CONDUIT SHALL BE USED FOR RECESSED FIXTURES FROM THE JUNCTION BOX TO THE FIXTURE NOT EXCEEDING A MAXIMUM LENGTH OF 6'-0". MINIMUM LENGTH FOR FLEXIBILITY SHALL BE 3'-0".
- MOUNTING HEIGHT OF LIGHTING FIXTURES, AS INDICATED ON THE DRAWINGS, IS FROM FINISHED FLOOR, PLATFORM, OR DECK TO BOTTOM OF FIXTURE.
- MINIMUM DISTANCE BETWEEN THE TOP OF CABLE TRAY AND BOTTOM OF THE STRUCTURAL STEEL DIRECTLY ABOVE IT SHALL BE 6". WHERE TWO TRAYS CROSS EACH OTHER, THE TOP OF THE LOWER TRAY TO THE BOTTOM OF THE TRAY ABOVE SHALL BE 6" MINIMUM.
- THE CONSTRUCTOR SHALL PROVIDE CONDUIT BODIES, FITTINGS, AND SUPPORTS NOT SHOWN ON THE DRAWINGS BUT REQUIRED BY JOB CONFIGURATION OR THE NEC.
- GROUND UNDERGROUND PIPING TO MAIN GROUNDING COUNTERPOISE.

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

WA-E-001	ABBREVIATIONS & ACRONYMS
WA-E-002	SCHEMATIC & WIRING DIAGRAM SYMBOLS
WA-E-004	ONE & THREE LINE DIAGRAM SYMBOLS

NO.	DATE	BY	CHK'D	ENGR	PROJ	DESCRIPTION

ISSUED FOR CONSTRUCTION	M. M.	6-25-96
DRAWN		
CHECKED		7-5-96
ENGINEER		7-8-96
PROJ		7/9/96



PARSONS
100 WEST WALNUT STREET
PASADENA, CALIFORNIA

LIGO
CALIFORNIA INSTITUTE OF TECHNOLOGY
MASSACHUSETTS INSTITUTE OF TECHNOLOGY

LASER INTERFEROMETER
GRAVITATIONAL-WAVE OBSERVATORY
SITE NO. 1 - HANFORD, WASHINGTON

TITLE	SHEET NUMBER	CONTRACT NUMBER	PROJECT NUMBER
ELECTRICAL STANDARD PLAN SYMBOLS	WA-E-002	PP150969	8094