


not be reproduced, copied, loaned, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.


This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will

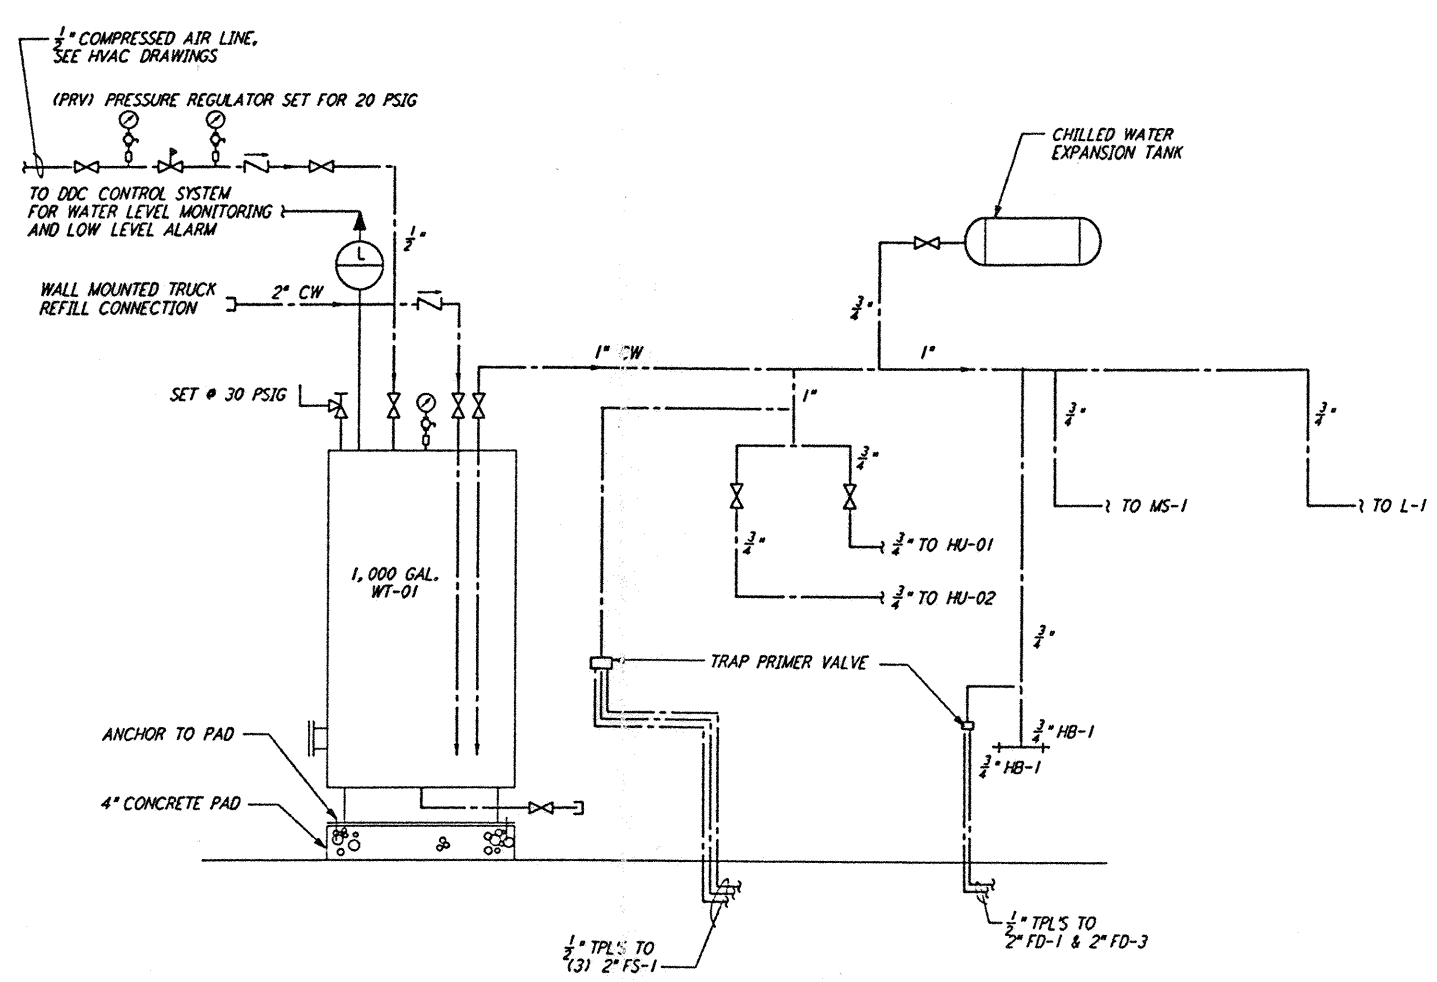


**DOMESTIC WATER SUPPLY SYSTEM**  
 (TYP. FOR 4 STATIONS)

**NOTES:**

1. SET THE LOW LEVEL ALARM OF THE WATER STORAGE TANK (WT-01) AT 200 GALLONS. SET THE MAXIMUM WATER LEVEL AT 900 GALLONS.

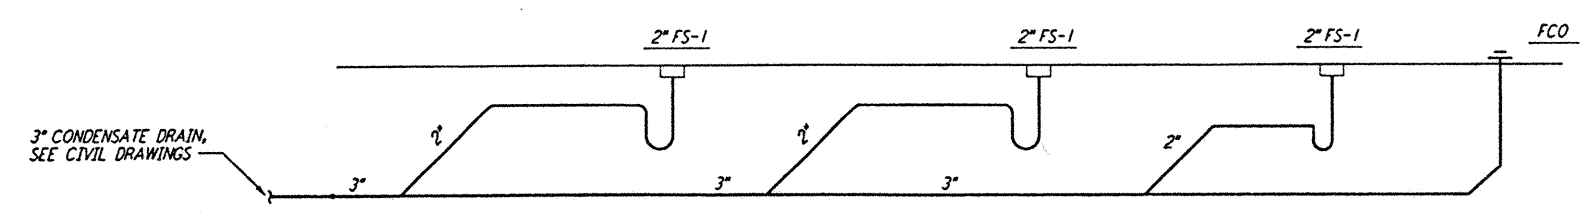

**SANITARY SEWER PIPING SCHEMATIC FOR MECH. ROOM 203**  
 (TYP. FOR 4 STATIONS)

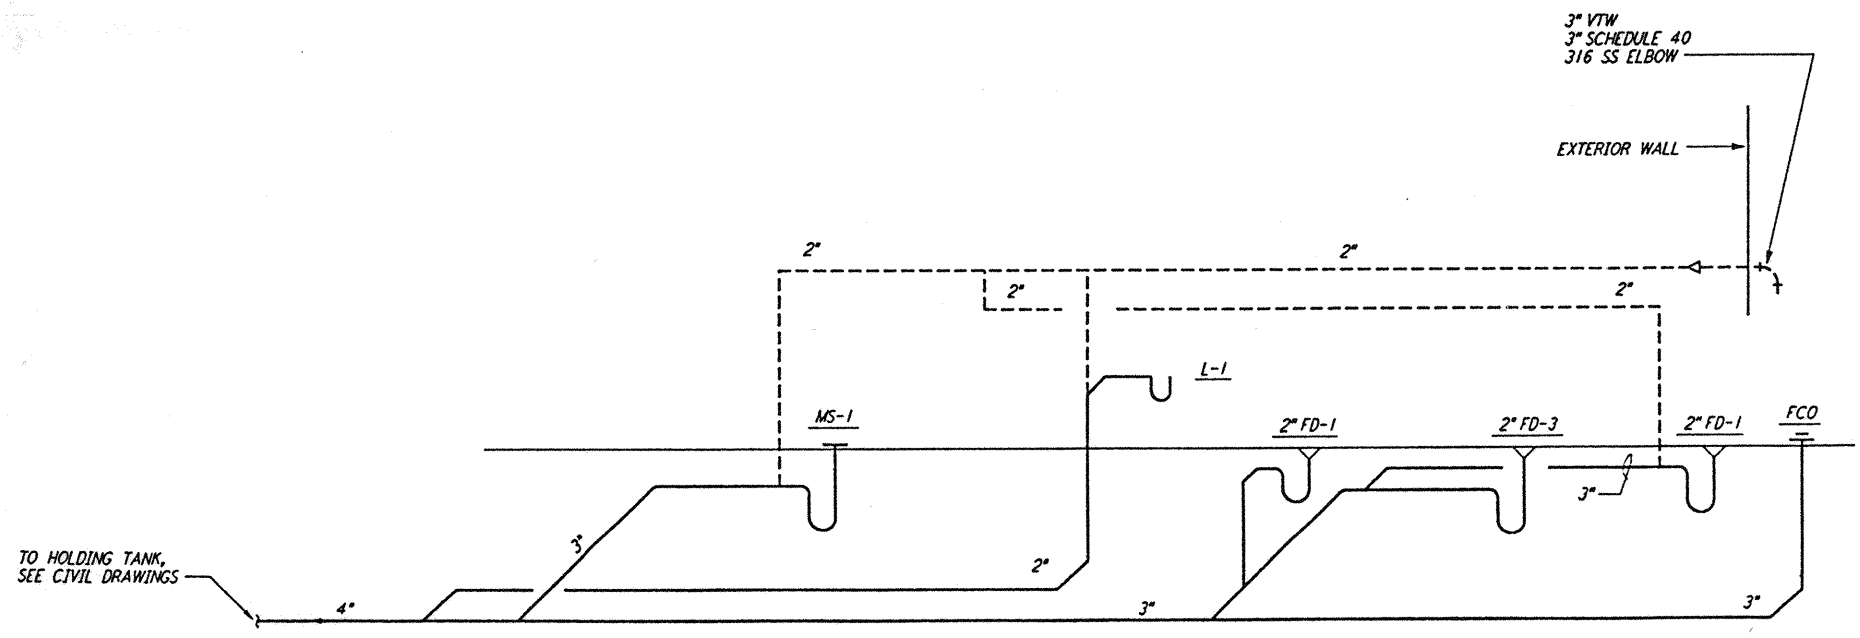

**SANITARY SEWER PIPING SCHEMATIC FOR RESTROOM & CLEANING AREA**  
 (TYP. FOR 4 STATIONS)

NO.	DATE	BY	CHK'D	ENGR	PROJ	DESCRIPTION
A	4-19-96	DG	MP	MJ		FINAL DESIGN REVIEW & BID

DRAWN	DG
CHECKED	
ENGINEER	
PROJ	

**PARSONS**  
 100 WEST WALNUT STREET  
 PASADENA, CALIFORNIA

**LIGO**  
 CALIFORNIA INSTITUTE OF TECHNOLOGY  
 MASSACHUSETTS INSTITUTE OF TECHNOLOGY

LASER INTERFEROMETER  
 GRAVITATIONAL-WAVE OBSERVATORY  
 SITE NO. 1 - HANFORD, WASHINGTON

TITLE: PLUMBING  
 MID & END STATIONS  
 RISER DIAGRAM & SCHEMATICS

SCALE: NONE  
 CONTRACT NUMBER: PP150969  
 PROJECT NUMBER: 8094

SHEET NUMBER: **WA-P-212**

LIGO-D960445-A-01