


GATE VALVE CONTROLLER

CONTROLLER TERM
BLOCK FUNCTIONS

- 16 → 24VDC
- 19 → OPEN/CLOSE (CLOSE=24V)
- 20 →
- 23 →
- 24 →

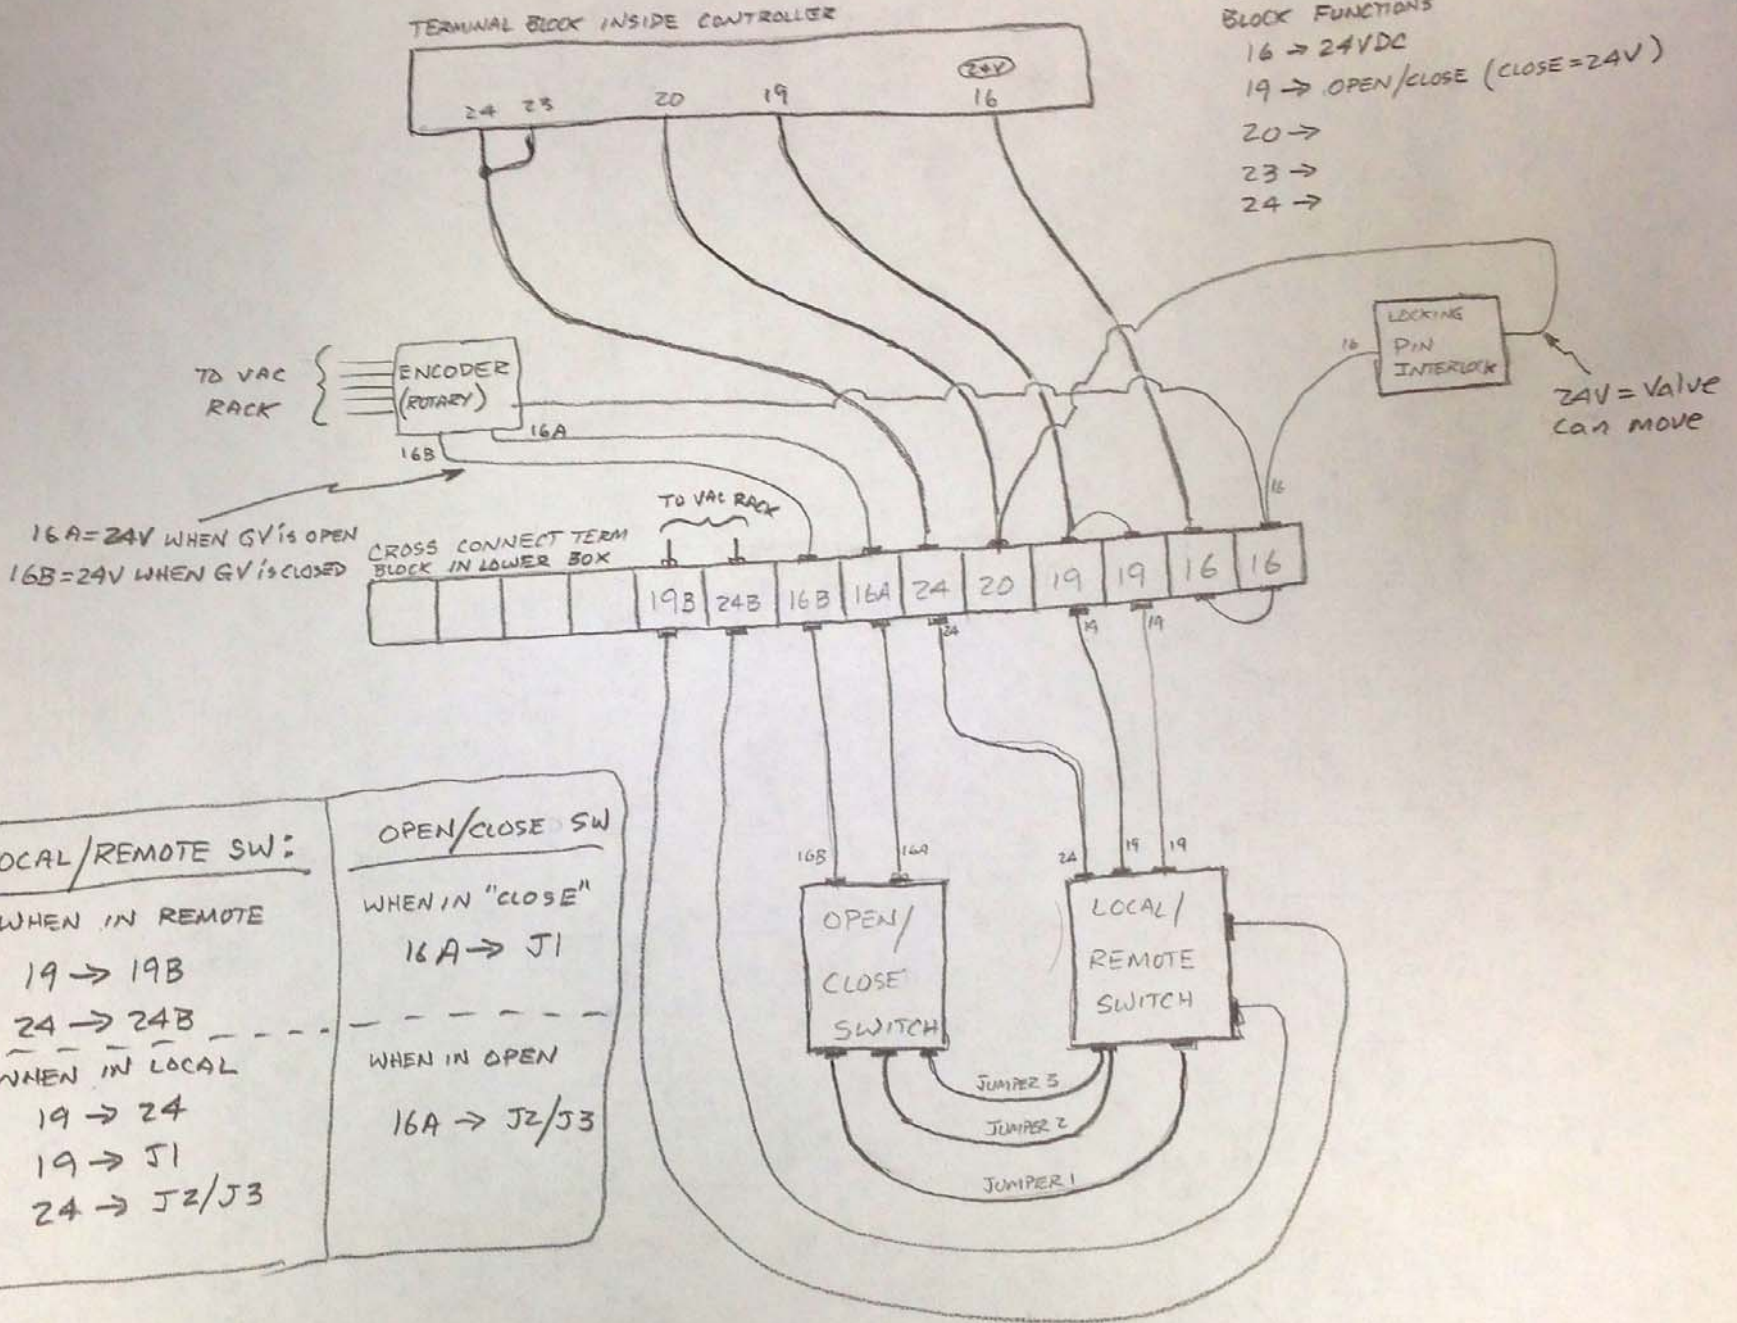

| LOCAL/REMOTE SW: | OPEN/CLOSE SW |
|------------------|-----------------|
| WHEN IN REMOTE | WHEN IN "CLOSE" |
| 19 → 19B | 16A → J1 |
| 24 → 24B | |
| WHEN IN LOCAL | WHEN IN OPEN |
| 19 → 24 | 16A → J2/J3 |
| 19 → J1 | |
| 24 → J2/J3 | |