

SITE PLAN
SCALE: 1" = 30"

0 30' 60'
SCALE IN FEET

N

CONSTRUCTION NOTES

- ① INSTALL 2 -4 INCH CONDUITS FOR OPTICAL FIBER. OPTICAL FIBER SHALL BE BY OTHERS. (APPROXIMATE LENGTH IS 450 FT FOR EACH OF TWO CONDUIT RUNS.) BURIAL DEPTH SHALL BE 30 INCHES BELOW GRADE MINIMUM. CONDUIT SHALL BE TELECOMMUNICATIONS GRADE HDPE, OR OWNER APPROVED EQUAL.
- ② INSTALL PULL BOXES (VAULTS) AT LOCATIONS SHOWN. VAULTS SHALL BE OLDCASTLE PRECAST 233-LA-INVERTED, 2X3.
- ③ TERMINATE CONDUIT AT DATA PANEL AS DIRECTED BY OWNER.
- ④ REMOVE ASPHALT FROM AREA DIRECTLY BETWEEN EXISTING TRANSFORMER AND THE BUILDING. CUT LINES SHALL BE STRAIGHT AND PERPENDICULAR TO THE BUILDING.

PRINTED BY: Gilbert Hibbs on 9/16/2014 4:00 PM

DRAWING NUMBER
308
REV
M1

LIGO HANFORD OBSERVATORY
DRAWING: LIGO- D10400308-V1


HIBBS ENGINEERING, INC.
KENNEWICK, WASHINGTON

LHO DCS FACILITY
ELECTRICAL / DATA
SITE PLAN

PROJECT NUMBER: 1071.010
CAD FILE: 107101A01.DWG

© 2014 Hibbs Engineering, Inc.

DRAWN BY: GLH
CHECKED BY:
DESIGN A/E DESIGN GM
HEI APPROVAL

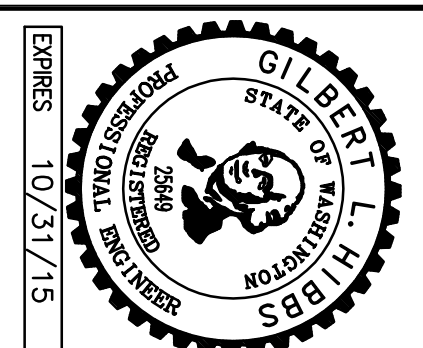

| REV # | DATE | BY | DESCRIPTION | APPROVED |
|-------|------|----|-------------|----------|
| | | | | |
| | | | | |

DATE OF ISSUE